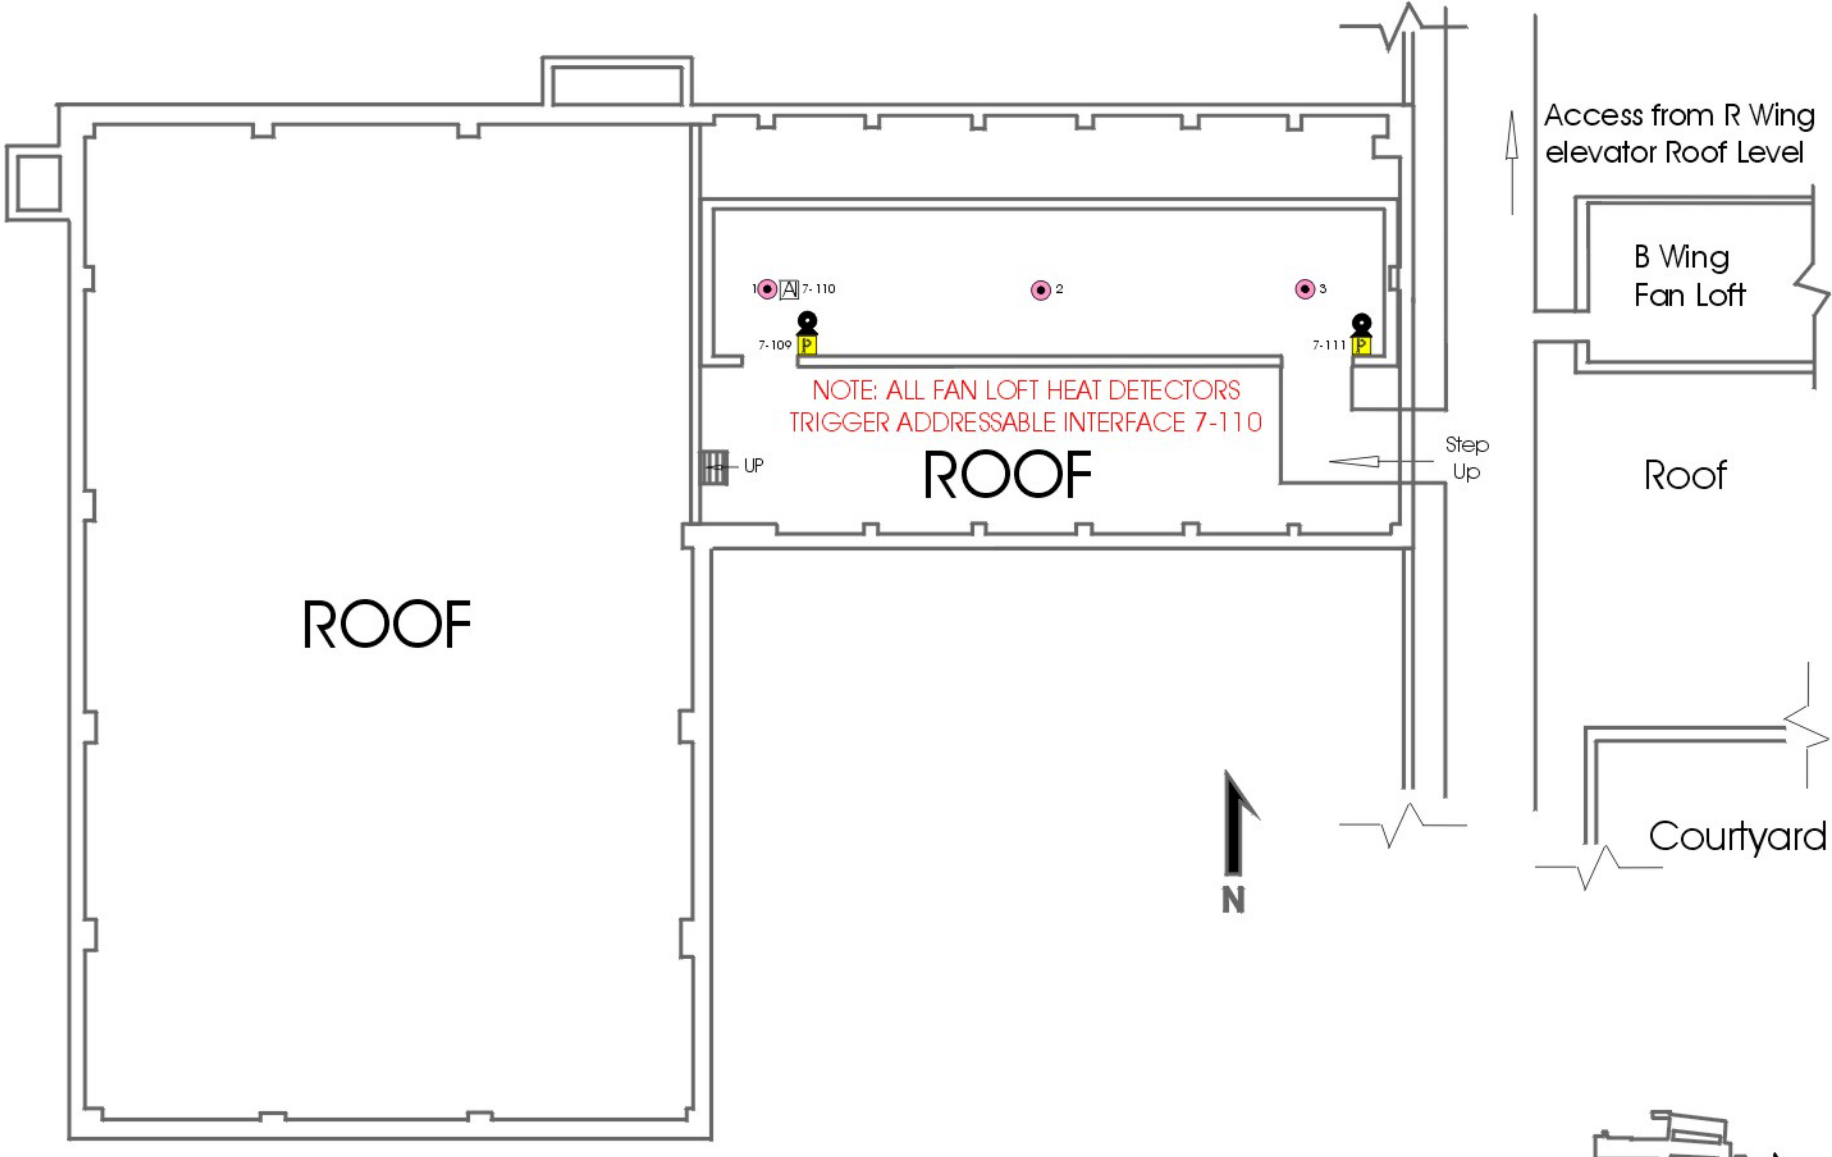

Building 200 System
K Wing, Fan Loft
Fire Alarm System Drawing
Revised 12/2/97

Legend (Addressable System)

- Bell
- Strobe
- Pull Station
- Waterflow Switch
- Pressure Switch
- Ionization Smoke
- Photo/Electric Smoke
- Fixed Temp Heat
- Fire Alarm Panel
- OS&Y Valve
- Inspectors Test
- FD Connection
- Standpipe
- P.I.V.

200K F.CDR